	<b>CITY OF AGOURA HILLS</b> <b>BUILDING &amp; SAFETY DIVISION</b> 30001 LADYFACE COURT AGOURA HILLS, CA 91301	<b>PHONE: (818) 597-7334</b> <b>FAX: (818) 597-7352</b> <b>www.AgouraHillsCity.org</b>
<b>NON-RESIDENTIAL EVCS SUBMITTAL CHECKLIST</b>		<b>OP-01G</b>   <b>4-15-22</b>

**2022 Checklist for Installing Non-Residential Electric Vehicle  
Charging Station (EVCS) at Existing Facilities**

Check One	Type of Charging Station(s) Proposed	Power Levels (Proposed circuit rating)	Typical NON-RES Charging Locations
<input type="checkbox"/>	Level 1	110/120 volt AC (15 or 20 Amps)	• Commercial
<input type="checkbox"/>	Level 2 – 3.3 kW (low)	208/240 VAC (20 or 30 Amps)	• Commercial Office Bldgs. • Public Access
<input type="checkbox"/>	Level 2 – 6.6 kW (medium)	208/240 VAC (40 Amps)	
<input type="checkbox"/>	Level 2 – 9.6 kW (high)	208/240 VAC (50 Amps)	
<input type="checkbox"/>	Level 2 – 19.2 kW (highest)	208/240 VAC (100 Amps)	
<input type="checkbox"/>	DC Fast Charging	440 or 480 VAC	• Public Access • Large Commercial Office Bldgs or park • Hospitality & Recreation
<input type="checkbox"/>	Other (provide detail)		


**PERMIT DESCRIPTION**

1. Submittal requirements:
  - a. Checklist
  - b. Electrical load calculation worksheet
  - c. Electrical permit application
  - d. Site plan
  - e. Single-line diagram (If applicable)
  - f. Manufacturer specifications
2. Does the scope of work on the plans match the electrical permit application description?  Yes  No

**ELECTRICAL LOAD CALCULATION**

1. Electrical load calculation is required, is it included in the submittal? (CEC 220)<sup>1</sup>  Yes  No
2. Based on the load calculation, is a new electrical service panel upgrade required?<sup>2</sup>  Yes  No
  - a. If yes, do plans include the electrical service panel upgrades?  Yes  No
  - b. If yes, has a separate permit been pulled for the panel upgrade?  Yes  No
3. Is the charging circuit appropriately sized for a continuous load (125%)?  Yes  No
4. Is the charging equipment proposed a Level 2 – 9.6kW station with a circuit rating of 50 amps or higher?  Yes  No
  - a. If yes, is a panel schedule showing phase loading with electrical calculations included with the single-line diagram?  Not Applicable  Yes  No

<sup>1</sup> 2019 California Electrical Code. Article 220 Branch-Circuit, Feeder, and Service Calculations.

	<p align="center"><b>CITY OF AGOURA HILLS</b></p> <p align="center"><b>BUILDING &amp; SAFETY DIVISION</b> 30001 LADYFACE COURT AGOURA HILLS, CA 91301</p>	<p align="right">PHONE: (818) 597-7334 FAX: (818) 597-7352 www.AgouraHillsCity.org</p>	
<p align="center"><b>NON-RESIDENTIAL EVCS SUBMITTAL CHECKLIST</b></p>		<p align="center"><b>OP-01G</b></p>	<p align="center"><b>4-15-22</b></p>

<sup>2</sup> The size of the existing service MUST be equal to or larger than the Minimum Required Size of main service breaker. If the existing service panel is **smaller** than the minimum required size of existing electrical services, then a **new upgraded electrical service panel must be installed**.

<sup>3</sup> 2019 California Green Buildings Standards Code. Title 24, Part 11, Section 5.106.5. *Nonresidential Mandatory measures.*



**CITY OF AGOURA  
HILLS  
BUILDING & SAFETY DIVISION  
30001 LADYFACE COURT  
AGOURA HILLS, CA 91301**

**PHONE: (818) 597-7334  
FAX: (818) 597-7352  
www.AgouraHillsCity.org**

**NON-RESIDENTIAL EVCS SUBMITTAL CHECKLIST**

**OP-01G**

**4-15-22**

**SITE PLAN & SINGLE LINE DRAWING**

1. If yes to section 2 Q2, is the required single-line diagram submitted for the proposed project?  Yes  No
  - a. Are mechanical ventilation requirements triggered for indoor venting requirements per (CEC 625.52(B))?  Yes  No
    - i. If yes, is a mechanical plan included with the permit application?  Yes  No
2. Is the site plan fully dimensioned and drawn to scale?  Yes  No
  - a. Showing location, size and use of all structures?  Yes  No
  - b. Showing the location of the electrical panel AND charging system?  Yes  No
  - c. Showing accessible route AND parking stall location?  Yes  No
  - d. Showing type of charging system and mounting?  Yes  No
  - e. Is the type of mounting for the charging system included if the charging system is not wall-mounted?  Not Applicable  Yes  No

**\*\*\*EVCS spaces will be required to follow 2019 CBC Chapter 11B Accessible Parking requirements \*\*\***

**Section 4: COMPLIANCE WITH 2019 CALIFORNIA ELECTRICAL CODE (TITLE 24, PART 3)**

1. Does the plan include EVCS manufacturer's specs and installation guidelines?  Yes  No
2. Does the site plan identify the amperage and location of existing electrical service panel?  Yes  No
  - a. If yes, does existing panel schedule have room for additional breakers?  Yes  No
  - b. Are sizes for the conduit and conductor included?  Yes  No
3. Is the charging unit rated more than 60 Amps or more than 150V to ground?  Yes  No
  - a. If yes, are disconnecting means provided in a readily accessible location in line of sight and within 50ft of EVCS? (CEC 625.43) ("Within sight" defined as 50')  Yes  No
4. Does the charging equipment have a Nationally Recognized Testing Laboratory (NRTL) approved listing mark? (UL 2202/UL 2200)  Yes  No
5. If trenching is required, is the trenching detail called out?  Yes  No
  - a. Is the trenching in compliance with electrical feeder requirements from structure to structure? (CEC 225)  Yes  No
  - b. Is the trenching in compliance of minimum cover requirements for wiring methods or circuits? (18" for direct burial per CEC 300)  Yes  No



**CITY OF AGOURA  
HILLS**  
**BUILDING & SAFETY DIVISION**  
 30001 LADYFACE COURT  
 AGOURA HILLS, CA 91301

PHONE: (818) 597-7334  
 FAX: (818) 597-7352  
 www.AgouraHillsCity.org

**NON-RESIDENTIAL EVCS SUBMITTAL CHECKLIST**

**OP-01G**

**4-15-22**

**Section 5: COMPLIANCE WITH 2019 CALGREEN MANDATORY MEASURES FOR NEW CONSTRUCTION AND 2019 CBC CHAPTER 11B ACCESSIBILITY REQUIREMENTS**

2019 CALGreen Mandatory EVCS requirements for New Construction<sup>3</sup>

1. **Note:** CALGreen requirements for non-residential apply to the following projects: New projects, additions or alterations that add 10+ parking spaces, provide designated parking for any combination of low-emitting, fuel-efficient, and carpool vehicles conforming to CALGreen Table 5.106.5.2.

Total number of parking spaces	Number of required spaces
0-9	0
10-25	2
26-50	4
51-75	7
76-100	9
101-150	13
151-200	18
201 and over	At least 10% of

2. **HOTEL/MOTEL:**

Is your project a new hotel or motel?

Yes  No

Should be identified during plan review (4.106.4.3 & 4.106.4.3.1)

Total number of parking spaces	Number of required EV Charging spaces
0-9	0
10-25	1
26-50	2
51-75	4
76-100	5
101-150	7
151-200	10
201 and over	At least 6% of total

**2019 CBC Chapter 11B (Disable Accessibility) Proposed EVCS Requirements**

Total Number Of EVCS At Facility	Minimum Number (by type) Of EVCS Required		
	Van Accessible	Standard Accessible	Ambulatory
1-4	1	0	0
5-25	1	1	0
26-50	1	1	1
>50	See CBC Table 11B-228.3.2.1		

- If installing between 1 and 4 EVCS parking stalls, does at least 1 EVCS parking stall meet Chapter 11B accessibility dimension requirements for a van accessible parking space (144" wide with adjacent access aisle) and access aisle (60" minimum width)(CBC Table 11B-228.3.2.1, 11B-402, 11B-812.5 & 11B-812.6.1)?  Yes  No
- If installing between 5 and 25 EVCS, is there at least 1 EVCS parking stall that meets Chapter 11B accessibility dimension requirements for a van accessible parking space (144" wide with an adjacent access aisle) and 1 EVCS parking stall that meets the standard accessible parking space (108" wide with an adjacent access aisle) (CBC Table 11B-228.3.2.1, 11B-812.6.1 & 812.6.2)?  Yes  No
- If installing 26 or more EVCS, please refer to Section 11B-812 for minimum accessible parking space requirements for van, standard and ambulatory stalls.
- Is there proper signage and markings for the EVCS parking stall(s) (CBC 11B-812.8)?  Yes  No
- Have the requirements for clear floor and operable parts been met with called out dimensions on the plans?  Yes  No
- Are the required markings for the access aisle provided (CBC 11B-812.7.2 & 812.7.3)?  Yes  No

CORRECTION(S) SUMMARY:

**NON-RESIDENTIAL EVCS SUBMITTAL CHECKLIST**


**OP-01G**

**4-15-22**

**EVCS INSTALLATION EXAMPLE #1:**

One to Four EVCS Spaces


\*One required van accessible space

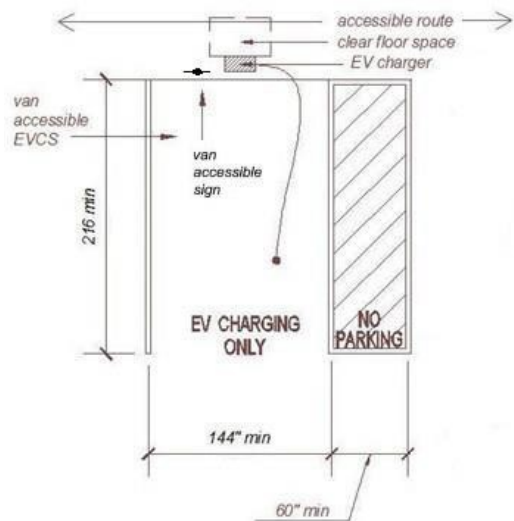

**EVCS INSTALLATION EXAMPLE #2:**

Five to Twenty Five EVCS Spaces

\*One required van accessible space and one required standard accessible space

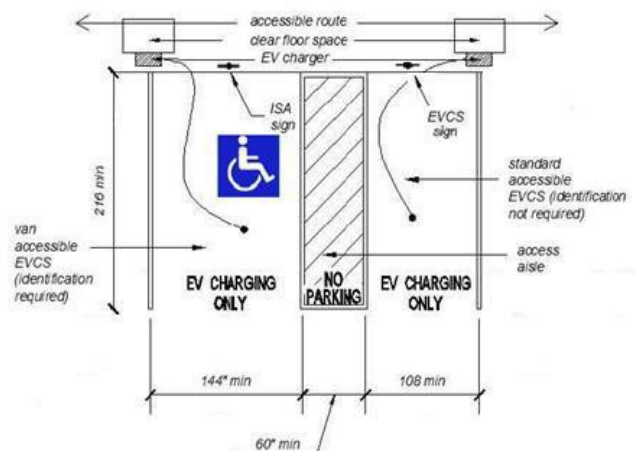

**Floor and ground surfaces** (CBC 11B-812.3): Access aisles shall be at the same level as the vehicle space they serve. Slope not to exceed 1:48.

**Clear floor or ground space** (CBC 11B-309.2 & 305.3): The clear floor or ground space shall be 30 inches minimum by 48 inches minimum.

**Access aisle- Markings** (CBC 11B-812.7.2): The color of the borderlines, hatched lines, and letters shall contrast with that of the surface of the access aisle. The blue color required for the identification of access aisles for accessible parking shall not be used.

**Accessible Route** (CBC 11B-202.4 Exception 10): Alterations solely for the purpose of installing EVCS at facilities where vehicle fueling, recharging, parking, or storage is not a primary function shall not be required to comply with section 11B-202.4 Path of Travel Requirements.

**Surface Markings** (CBC 11B-812.9): EVCS vehicle spaces shall provide surface marking stating "EV CHARGING ONLY" in letters 12" high minimum.

**Identification signs – Location** (CBC 11B-812.8.7): Signs shall be permanently posted either immediately adjacent to the vehicle space or within the projected vehicle space width at the head end of the vehicle space. Signs identifying van-accessible vehicle spaces shall contain the designation "van accessible."

- Minimum 60" above the finish floor or ground surface
- Located within an accessible route: Minimum 80" ground surface
- Identification signs shall be reflectorized with a minimum area of 70 square inches. (CBC 11B-812.8.6)

**Identification signs- Five to twenty-five** (CBC 11B-812.8.3): One van accessible EVCS shall be identified by an ISA complying with section 11B-703.7.2.1. The required standard accessible EVCS shall not be required to be identified

	<p align="center"><b>CITY OF AGOURA HILLS</b></p> <p align="center"><b>BUILDING &amp; SAFETY DIVISION</b> 30001 LADYFACE COURT AGOURA HILLS, CA 91301</p>	<p align="right">PHONE: (818) 597-7334 FAX: (818) 597-7352 www.AgouraHillsCity.org</p>	
<p align="center"><b>NON-RESIDENTIAL EVCS SUBMITTAL CHECKLIST</b></p>		<p align="center"><b>OP-01G</b></p>	<p align="center"><b>4-15-22</b></p>

with an ISA.

**Operable parts** (CBC 11B-812.10.2 & 308): Reach ranges shall comply with forward reach or side reach requirements per section 11B-308.