

**LEGEND**

- SS — PROPOSED SEWER LINE
- W — PROPOSED WATER LINE
- E — PROPOSED ELECTRICAL LINE
- W(P) --- EXISTING WATER LINE
- 8" SS --- EXISTING SEWER LINE
- E(P) --- EXISTING ELECTRICAL LINE
- --- ABANDONED UTILITIES LINE
- [M] 200 AMP, 1-PHASE, NEMA 3R METER PEDESTAL
- [HH] PROPOSED HAND HOLE

**GENERAL NOTES**


1. THE EXISTING UTILITIES SHOWN ON THE PLAN ARE BASED ON AVAILABLE RECORDS. THE CONTRACTOR MUST FIELD DETERMINE THE LOCATION AND DEPTH OF ALL UTILITIES PRIOR TO ANY CONSTRUCTION. REPORT DISCREPANCIES AND POTENTIAL CONFLICTS WITH PROPOSED UTILITIES TO DESIGN ENGINEER PRIOR TO INSTALLATION OF ANY PIPING.
2. CONTRACTOR SHALL OBTAIN PERMIT FOR ELECTRICAL CONNECTIONS FROM COUNTY OF LOS ANGELES AND SOUTHERN CALIFORNIA EDISON (SCE) AND PAY FOR ALL APPLICABLE PERMITS AND FEES.
3. CONTRACTOR SHALL BE RESPONSIBLE FOR ALL FINAL CONNECTIONS FOR ELECTRICAL AT THE EXTERIOR OF THE RESTROOM BUILDING.
4. CONTRACTOR SHALL PROVIDE AND CONNECT THE INTERIOR BUILDING UTILITY CONNECTIONS AND MAKE THE EXTERIOR CONNECTIONS TO THE POINT OF CONNECTION SERVICES, AS APPROVED BY SCE.

**KEYED NOTES**

- (E1) PROVIDE NEW SCE HH-4 APPROVED HAND HOLE PER DETAIL 2 SHEET 10 FOR UTILITY CONNECTION POINT AND INSTALL PER SCE SPECIFICATIONS AND REQUIREMENTS. COORDINATE FINAL LOCATION WITH SCE.
- (E2) PROVIDE NEW 200A, 120/240V, 1-PHASE, 3-WIRE, NEMA 3R, 22K AIC SERVICE ENTRANCE SECTION PAD MOUNTED METER PEDESTAL PER DETAIL 1 SHEET 10 AND INSTALL PER SCE SPECIFICATIONS AND REQUIREMENTS.
- (E3) PROVIDE (1) 2-1/2" SCHEDULE 40 PVC UNDERGROUND CONDUIT WITH (3) #3/0 AWG CU XHHW CONDUCTORS AND (1) #6 AWG CU GROUND FROM THE SERVICE METER PEDESTAL TO THE PROPOSED RESTROOM ELECTRICAL PANEL.
- (E4) PROVIDE (1) 2-1/2" SCHEDULE 40 PVC UNDERGROUND SPARE CONDUIT WITH DETECTABLE PULL ROPE FROM THE SERVICE METER PEDESTAL TO THE PROPOSED RESTROOM ELECTRICAL PANEL.
- (E5) PROVIDE (1) 4" UNDERGROUND CONDUIT FOR SCE SERVICE FROM HAND HOLE TO SERVICE METER PEDESTAL. INSTALL PER SCE SPECIFICATIONS AND REQUIREMENTS. COORDINATE WITH SCE PLANS FOR FINAL LOCATION. CONDUCTORS AND CONNECTIONS TO BE PROVIDED BY SCE.
- (E6) PROVIDE (1) 4" UNDERGROUND CONDUIT VIA HORIZONTAL DIRECTIONAL DRILLING METHOD (HDD) FOR SCE SERVICE FROM EXISTING SCE HAND HOLE TO PROPOSED SCE HAND HOLE AS INDICATED ON THE PLANS. INSTALL PER SCE SPECIFICATIONS AND REQUIREMENTS. COORDINATE WITH SCE PLANS FOR FINAL LOCATION. CONDUCTORS AND CONNECTIONS TO BE PROVIDED BY SCE.
- (E7) EXISTING SCE SERVICE HAND HOLE TO BE UTILIZED FOR PROPOSED UTILITY CONNECTION. FIELD VERIFY AND PROTECT IN PLACE. COORDINATE WITH SCE PLANS FOR FINAL LOCATION. CONDUCTORS AND CONNECTIONS TO BE PROVIDED BY SCE.
- (E8) EXISTING TELCO/FO UTILITY TO REMAIN. FIELD VERIFY AND PROTECT IN PLACE.
- (E9) BORE PIT SHOWN FOR REFERENCE. COORDINATE SIZE AND FINAL LOCATION WITH SCE SPECIFICATIONS AND REQUIREMENTS.

10' EASEMENT OF THE COUNTY OF LOS ANGELES PER O.R. D-4471 PG. 438 FOR SANITARY SEWER PURPOSES

LOT 94  
TRACT MAP NO. 30907  
M.B. 799/27-33  
A.P.N. 2048-007-901

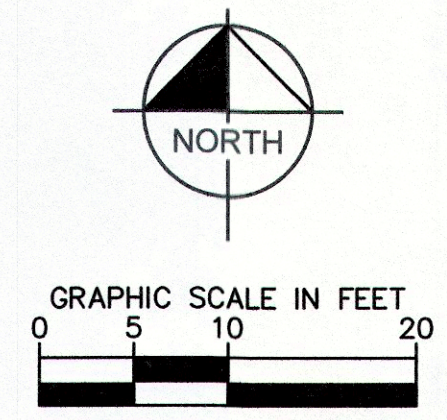

REVISION #	SYMBOL	DESCRIPTION OF CHANGE	APPROVED	DATE
1	▲	ADDENDUM 1	APPROVED	07/30/24



PREPARED BY AND/OR UNDER THE SUPERVISION OF:

*Michael Colombo*  
MICHAEL COLOMBO, P.E.  
7/30/2024 DATE

CITY OF AGOURA HILLS APPROVAL

**Kimley»Horn**

© 2021 KIMLEY-HORN AND ASSOCIATES, INC.  
660 S. FIGUEROA STREET, SUITE 2050, LOS ANGELES, CA 90017  
PHONE: 213-261-4040  
WWW.KIMLEY-HORN.COM

*Jessica Forte*  
JESSICA FORTE, P.E.  
CITY ENGINEER  
7/30/24 DATE  
80486 RCE NO.  
3/31/24 EXP DATE



CHUMASH PARK RESTROOM REHABILITATION PROJECT

**ELECTRICAL SITE PLAN**

SHEET 9 OF 10

CITY OF AGOURA HILLS DWG. NO. *11824-04*